


Kongres Container

Battery cabinet installation diagram

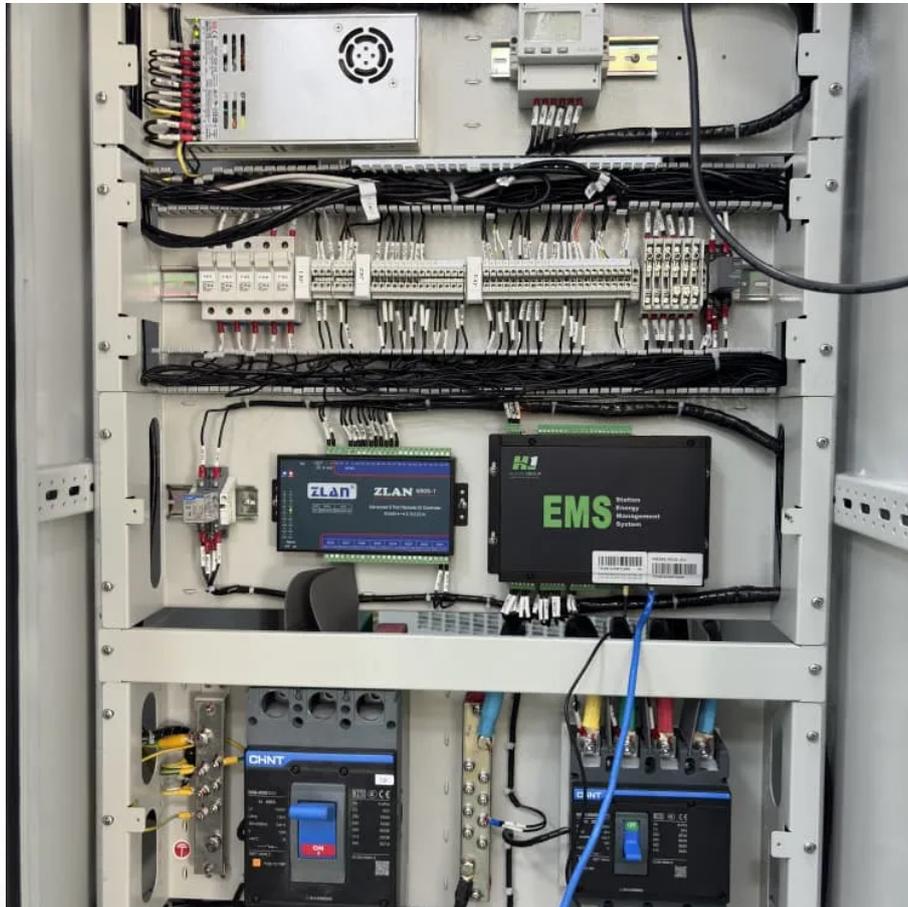

Overview

How do I install a battery cabinet?

The installer should be familiar with the installation requirements and techniques to be used in securing the battery cabinet to a relay rack or wall. The battery cabinet is designed to mount on a wall or a standard 23" wide relay rack. Refer to Figure 3 and install the 23" relay rack mounting angles to the battery cabinet.

How is a battery system installed?

installed on a level floor suitable for computer or electronic equipment. Each cabinet in the battery system is placed in its correct location. A cabinet ground g/mounting kit is installed between any cabinets that are bolted together. A ground wire is installed between all cabinets. All conduits and cables are properly routed to the battery.

How do I install a UPS battery?

the UPS: Create an installation plan for the battery cabinet (Chapter 3). Prepare your site for the battery cabinet (Chapter 3). Inspect and unpack the battery cabinet (Chapter 3). Unload and install the battery cabinet, and wire the system (Chapter 4). Complete the Installation Checklist (Chapter 4). Have authority.

How do I install the 9395 model IBC-L Battery Cabinet?

serve a preferred startup date. 1.1 Configuration and installation features The 9395 Model IBC-L battery cabinet is designed to be installed in a standalone configuration using up to two battery cabinets. Power wiring is installed externally between each battery cabinet and the UPS or battery disconnect using conduit. Battery.

Where is the battery cabinet located?

The location for the battery cabinet is on the right side of the UPS cabinet. This location will allow for future expansion using an external module. Cabinets can

be permanently bolted to the floor or left standing on leveling feet. Power and control wiring can be routed through the top or bottom of the cabinet depending on inst.

How do I connect a battery cabinet to an ups?

In systems with more battery cabinets, only the system BMS of battery cabinet 1 (the battery cabinet closest to the UPS) is connected to the UPS. Remove signal cable 0W13441 between the SMPS I/O port and the DRY CONTACT ports on battery cabinet 2 and battery cabinet 3. • SG IO 1: Used for sending signals for minor and major alarms to the UPS.

Battery cabinet installation diagram

Contact Us

For catalog requests, pricing, or partnerships, please visit:
<https://www.drugiswiatowykongrespolakow.pl>