


## Kongres Container

# Uruguay Home Outdoor Communication Power Supply BESS

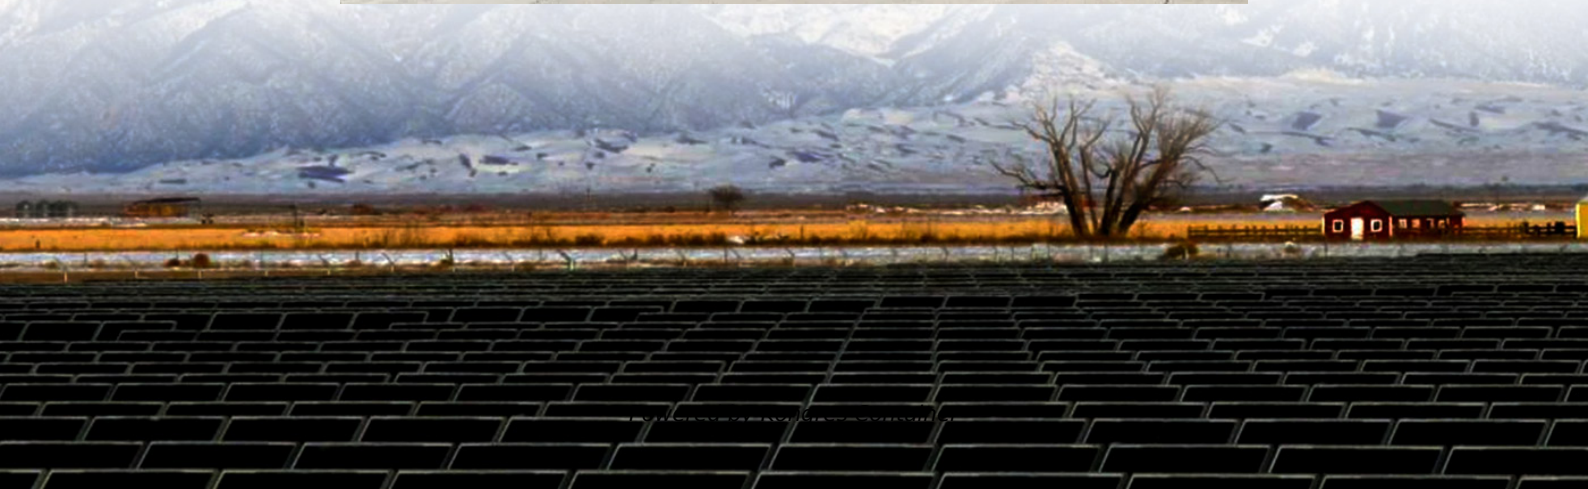

## Overview

---

Who is responsible for the electricity costs associated with Bess auxiliary loads?

Project owners are also responsible for the electricity costs associated with the BESS auxiliary load during operation. The electricity cost for auxiliary loads depends on the energy consumption (kWh) and the pricing structure set by independent system operators or utilities. For example:.

What if a Bess product does not meet backup power requirements?

If a BESS product cannot meet these backup power requirements as mandated by the code or the Authority Having Jurisdiction (AHJ), an external backup power source needs to be provided. Options for backup power include local distribution network feeders (if available with sufficient kVA rating) or backup generators.

Why is auxiliary power important in Bess project design & development?

As discussed above, auxiliary power is a vital consideration in BESS project design and development. While it is an important aspect, a comprehensive approach, such as the total cost of ownership method, should be used for BESS product evaluation and selection.

## Uruguay Home Outdoor Communication Power Supply BESS

---

### Contact Us

---

For catalog requests, pricing, or partnerships, please visit:  
<https://www.drugiswiatowykongrespolakow.pl>